SCHEDULE (C).—PART III.—(*See* § 5.)

Conditions for determining the Rates to which Buildings of the Second or Warehouse Class are to be deemed to belong, and the Thickness of the External and of the Party Walls thereof.

In reference to Height.	In reference to Area.	In reference to Stories.	Rate of Building.	Requisite Thickness of the External Walls of each Rate of the Second Class.	Requisite Thickness of the Party-Walls of each Rate of the Second Class.
1. If the building be in height not more than 12 feet,	- - If the building do not cover more than 6 squares,	- - If the building do not contain in height more than one story,	- - It is to be of the First or Lowest Rate of this Class,	- - And the thickness of the external walls must be, at the least, 9½ inches from the top of the footing to the top of the wall.	- - And the thickness of the party-walls must be, at the least, 13½ inches from the top of the footing to the top of the wall.
2. If more than 12, and not more than 22 feet,	- - or if it cover more than 6, and less than 10 squares,	- - or if it contain two stories,	- - It is to be of the Second Rate.	- - And the thickness of the external walls must be, at the least, 13½ inches from the top of the footing to the under-side of the gutter-plate; and, at the least, 9½ inches from the under-side of the gutter-plate to the top of the wall.	- - And the thickness of the party-walls must be, at the least, 17½ inches from the top of the footing to the under-side of the second floor, and 13½ inches from the under-side of the second floor to the top of the wall.
3. If more than 22, and not more than 36 feet,	- - or if it cover more than 10, and less than 16 squares,	- - or if it contain three stories,	- - It is to be of the Third Rate.	- - And the thickness of the external walls must be, at the least, 17½ inches from the top of the footing to the under-side of the second floor; and, at the least, 13½ inches from the under-side of the second floor to the under-side of the gutter-plate; and, at the least, 9½ inches from the under-side of the gutter-plate to the top of the wall.	- - And the thickness of the party-walls must be, at the least, 17½ inches from the top of the footing to the under-side of the third floor, and, at the least, 13½ inches from the under-side of the third floor to the top of the wall.
4. If more than 36, and not more than 55 feet,	- - or if it cover more than 16, and less than 25 squares,	- - or if it contain five stories,	- - It is to be of the Fourth Rate.	- - And the thickness of the external walls must be, at the least, 17½ inches from the top of the footing to the under-side of the third floor; and, at the least, 13½ inches from the under-side of the third floor to the under-side of the gutter-plate; and, at the least, 9½ inches from the under-side of the gutter-plate to the top of the wall.	- - And the thickness of the party-walls must be, at the least, 22 inches from the top of the footings to the under-side of the second floor, and, at the least, 17½ inches from the under-side of the second floor to the under-side of the fifth floor, and at the least, 13½ inches from the under-side of the fifth floor to the top of the wall.
5. If more than 55, and not more than 65 feet,	- - or if it cover more than 25 squares,	- - or if it contain six stories,	- - It is to be of the Fifth Rate.	- - And the thickness of the external walls must be, at the least, 22 inches from the top of the footing to the under-side of the second floor; and, at the least, 17½ inches from the under-side of the second floor to the under-side of the fourth floor; and, at the least, 13½ inches from the under-side of the fourth floor to the under-side of the gutter-plate; and, at the least, 9½ inches from the under-side of the gutter-plate to the top of the wall.	- - And the thickness of the party-walls must be, at the least, 22 inches from the top of the footings to the under-side of the third floor; and, at the least, 17½ inches from the under-side of the third floor to the top of the wall.
6. If more than 65 feet	- - or if it cover more than 35 squares,	- - or if it contain more than six stories,	- - It is to be of the Sixth Rate, and of the Third Class.	- - And the thickness of the walls must be, at the least, 4 inches thicker than is hereby required for walls of the fifth rate.	- - And the thickness of the party-walls must be, at the least, 4 inches thicker than is hereby required for walls of the fifth rate.

SECOND OR WAREHOUSE CLASS.

Party Walls.

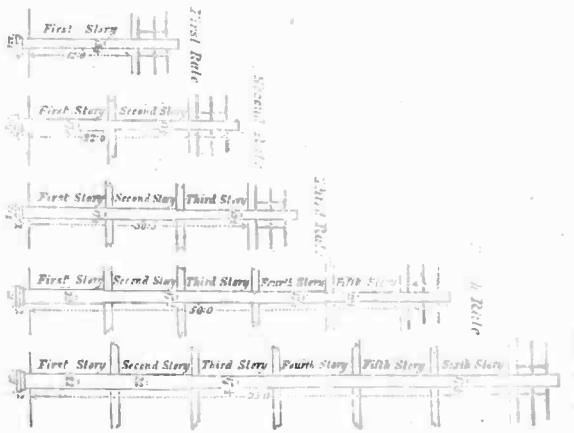

The measurements of stories given in the accompanying illustrations are intended merely to show what heights of stories may be introduced into the height to which each rate of building is limited.

To learn about PDF Compression and OCR visit our website